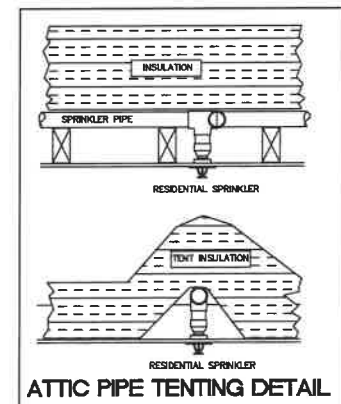


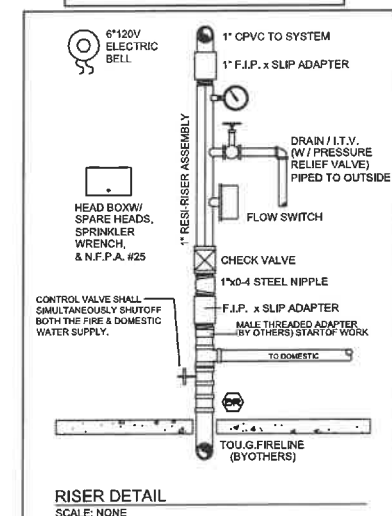

SPRINKLER SPACING
MAX SPRINKLER SPACING - 12X12
MAX DISTANCE FROM WALL / OBSTRUCTIONS 6FT.
MINIMUM DISTANCE BETWEEN SPRINKLERS 8FT.

COMPARTMENTS CONTAINING ONE SPRINKLER
MAX SPRINKLER SPACING - 12X12
MAX DISTANCE FROM WALL / OBSTRUCTION 6FT.
MINIMUM DISTANCE BETWEEN SPRINKLERS 8FT.

SPRINKLERS SHALL BE LOCATED A MINIMUM OF 3 FEET FROM THE CENTER OF FANS OR AN ADDITIONAL SPRINKLER SHALL BE PLACED ON THE OPPOSITE SIDE OF FAN



HYDRAULIC DESIGN DATA	
REMOTE AREA	1
AREA LOCATION	BEDROOM
DESIGN STD.	130
# OF FLOWING SPRINKLERS	2
DENSITY	.05 G.P.M./SQ.FT.
MAX SPRINKLE SPACING	256-SQ.FT.
DEMAND AT SOURCE CONNECTION	
FLOW	10 G.P.M.
PRESSURE	43.3 P.S.I.
DEMAND AT BASE OF RISER	
FLOW	18 G.P.M.
PRESSURE	16.4 P.S.I.

[illegible]

PROJECT NOTE:
THE PROPOSED IS AN EXISTING RESIDENCE
WITH A NEW 13D SPRINKLER SYSTEMS BEING
INSTALLED THROUGHOUT. .